


Automat 3" Model 146M

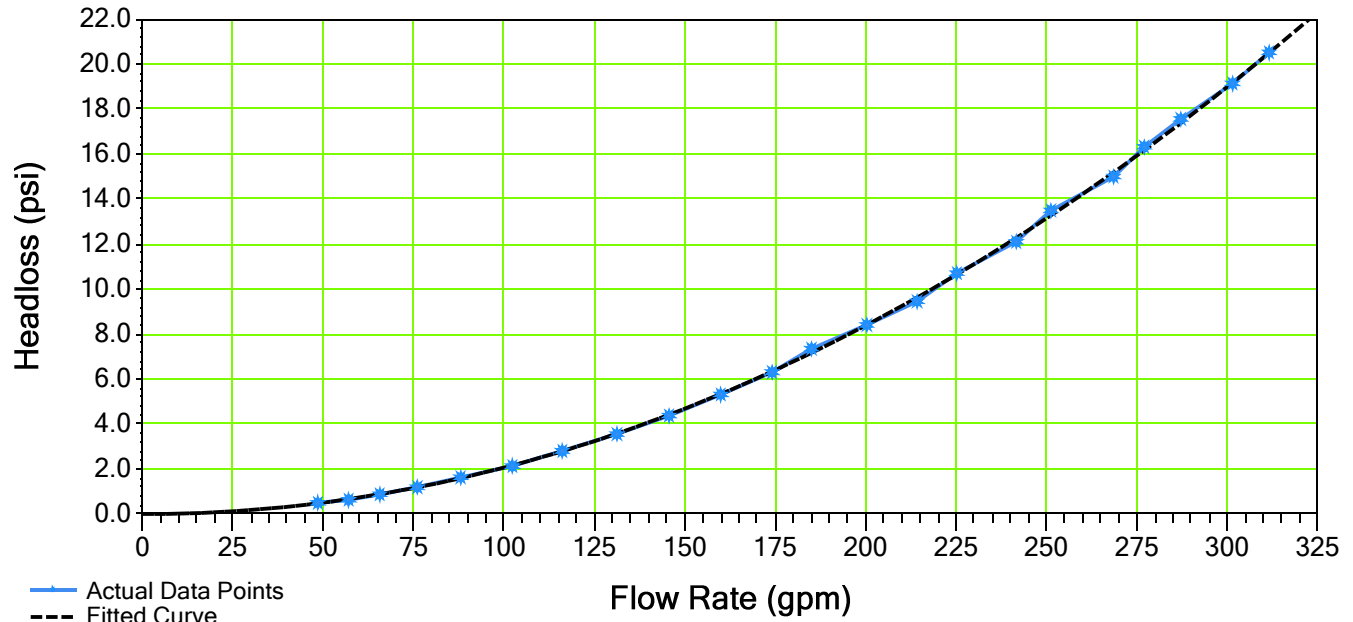

Test psi: 50.0

HL = 0.000191608600 Q².01704
 R² = 1.000
 CV = 69.2

Test Date: 01/16/15

Flow Rate (gpm)	Headloss (psi)	Estimate	Residual
48.5	0.50	0.48	-3.8 %
57.0	0.64	0.67	4.0 %
65.6	0.88	0.89	0.6 %
76.0	1.20	1.19	-0.7 %
88.0	1.63	1.60	-1.8 %
102.3	2.14	2.17	1.4 %
116.1	2.81	2.80	-0.3 %
131.2	3.56	3.58	0.7 %
145.6	4.38	4.42	0.9 %
159.9	5.32	5.34	0.4 %
174.1	6.31	6.34	0.5 %
185.0	7.35	7.17	-2.5 %
200.3	8.41	8.41	0.0 %
214.2	9.46	9.63	1.8 %
225.2	10.71	10.66	-0.5 %
241.6	12.11	12.28	1.4 %
251.2	13.50	13.28	-1.6 %
268.5	15.01	15.19	1.2 %
277.0	16.33	16.18	-0.9 %
287.1	17.57	17.39	-1.0 %
301.4	19.15	19.18	0.2 %
311.5	20.53	20.50	-0.1 %